

**ON-SITE
STORM WATER
SOURCE
CONTROLS**

**Typical
Rainwater Tank
with Infiltration
Design**

Storm Water
Management
South Side Lot

DATE: DEC. 14, 2016

REV. NO.: 0


DWG.No.: SWMP - 04

SCALE: AS SHOWN

DRAWN: JN

CHECKED: DTM


APPROVED: DTM

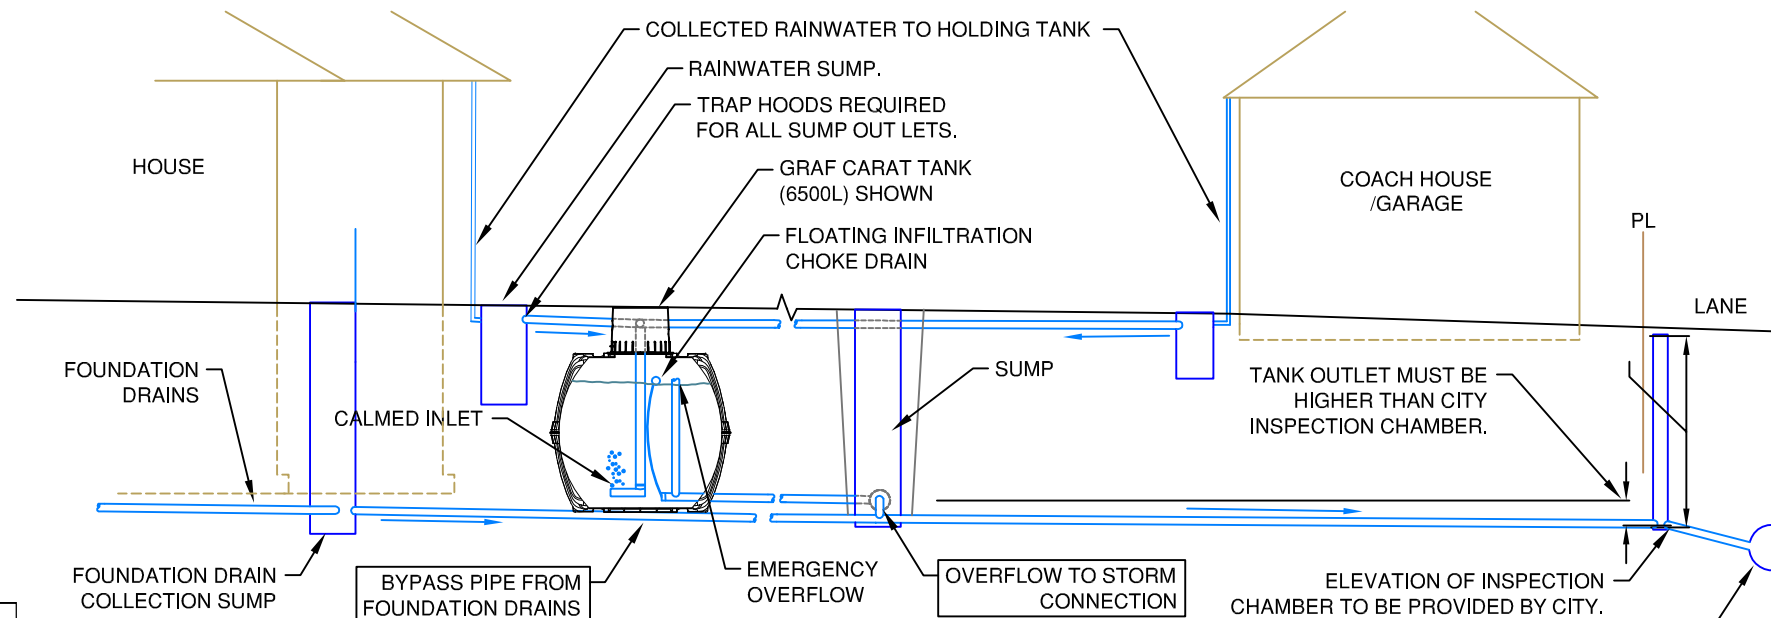

PROFILE VIEW


SCALE 1:100

NOTE: LOCKING LIDS ARE REQUIRED FOR THE TANKS. NO LADDERS INSIDE THE TANKS.

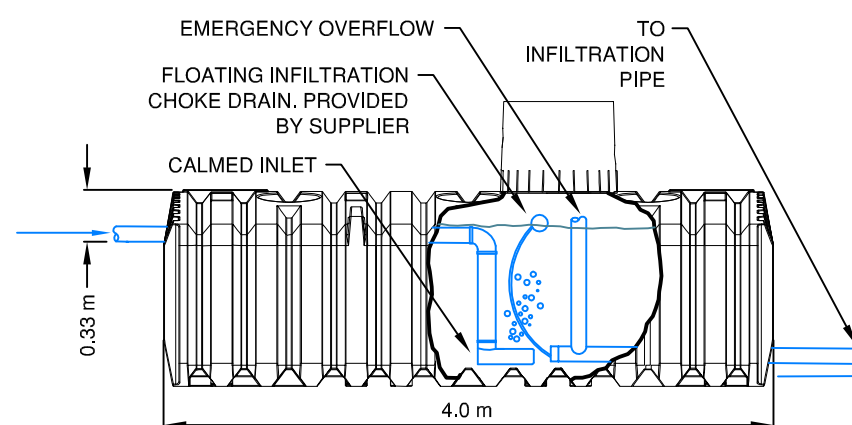


NORWESCO 9400 I TANK CONFIGURATION

1:50

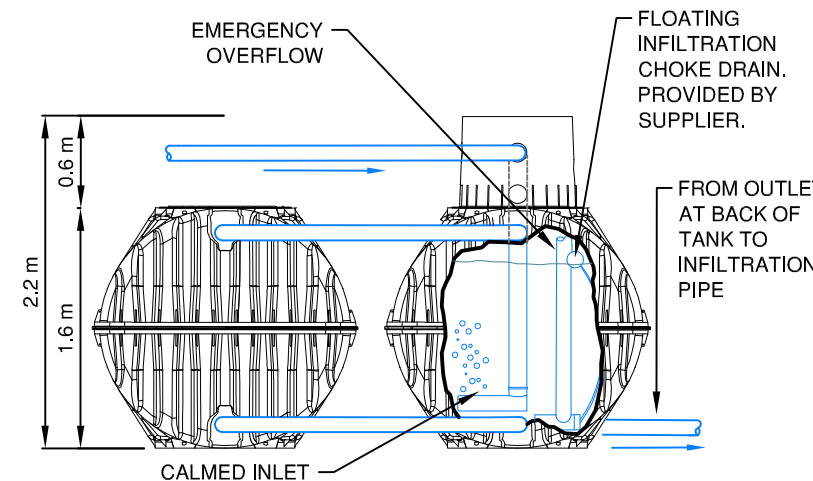


2 - 3750 I CARAT TANKS CONFIGURATION

1:50

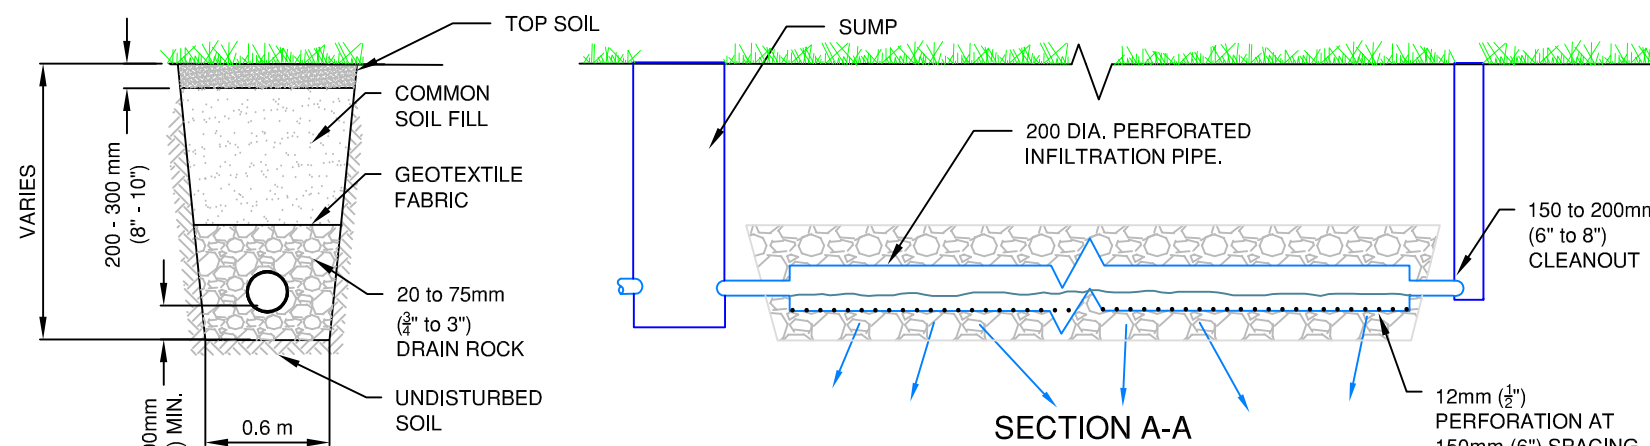

PERFORATED INFILTRATION DRAIN DETAIL

NOT TO SCALE

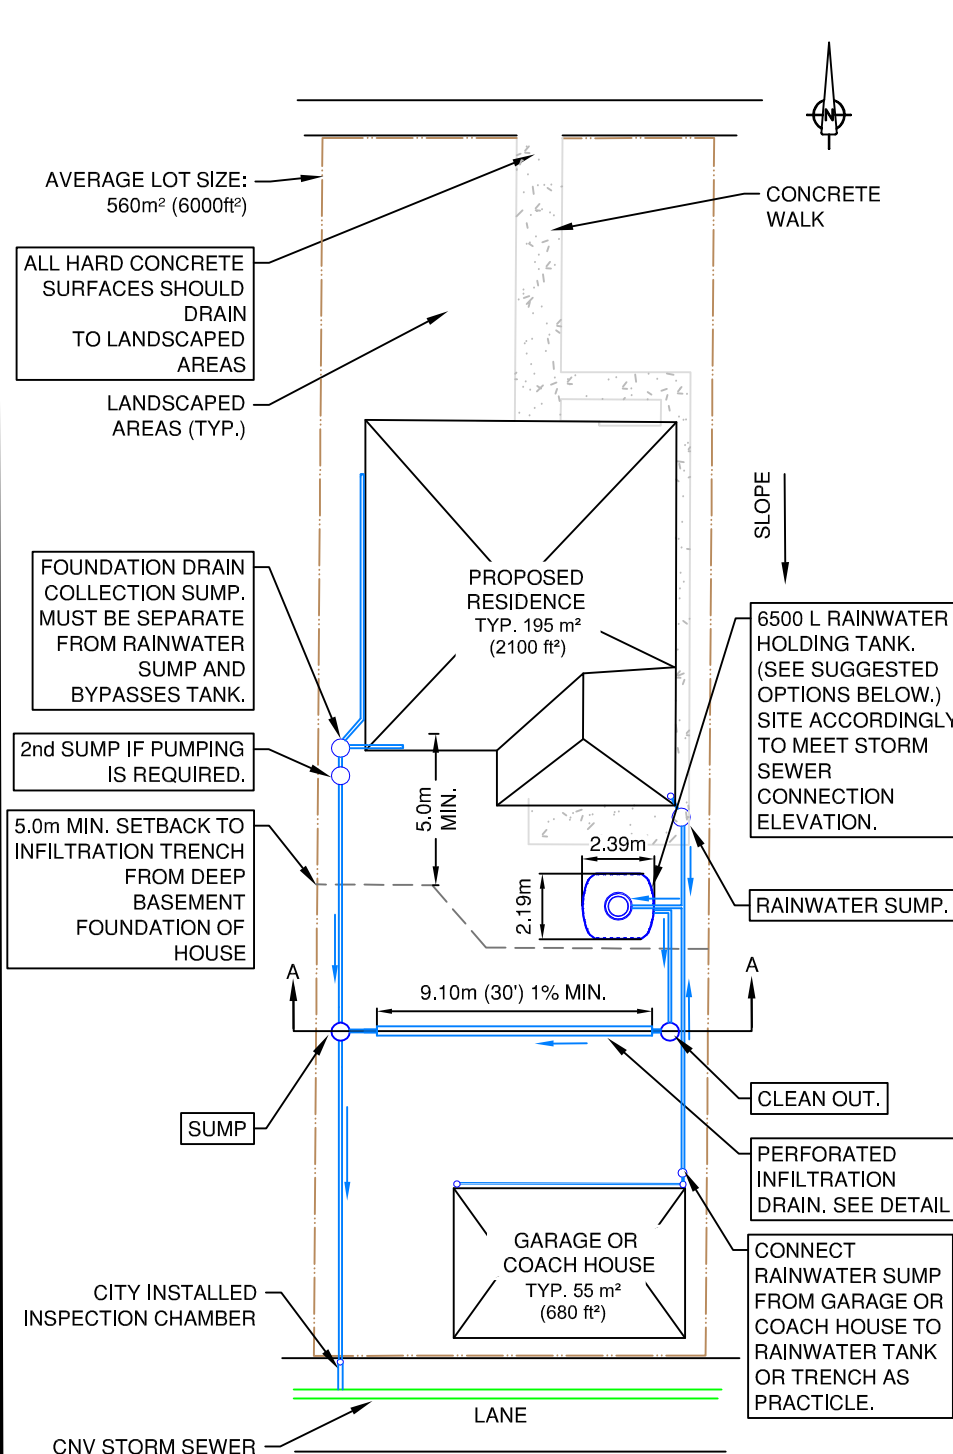

SOUTH SIDE LOT

SCALE 1:250

SUGGESTED RAINWATER TANKS

NAME	VOLUME (LITER)	COMPANY	CONTACT	TOTAL HEIGHT	
GRAF CARAT 6500 I	6500	BARR PLASTICS	604-852-8522	2.7 m (8'11")	TALLEST TANK
GRAF CARAT 3750 I (2 TANK) SYSTEM	7500	BARR PLASTICS	604-852-8522	2.2 m (7'3")	MID HEIGHT
NORWESCO 9400 I HOLDING TANK C/W GRAF FLOATING OUTLET.	9400	BARR PLASTICS	604-852-8522	1.3 m (4'2")	LOWEST PROFILE